




## Exploded Parts Manual CRTE



**PARTS**

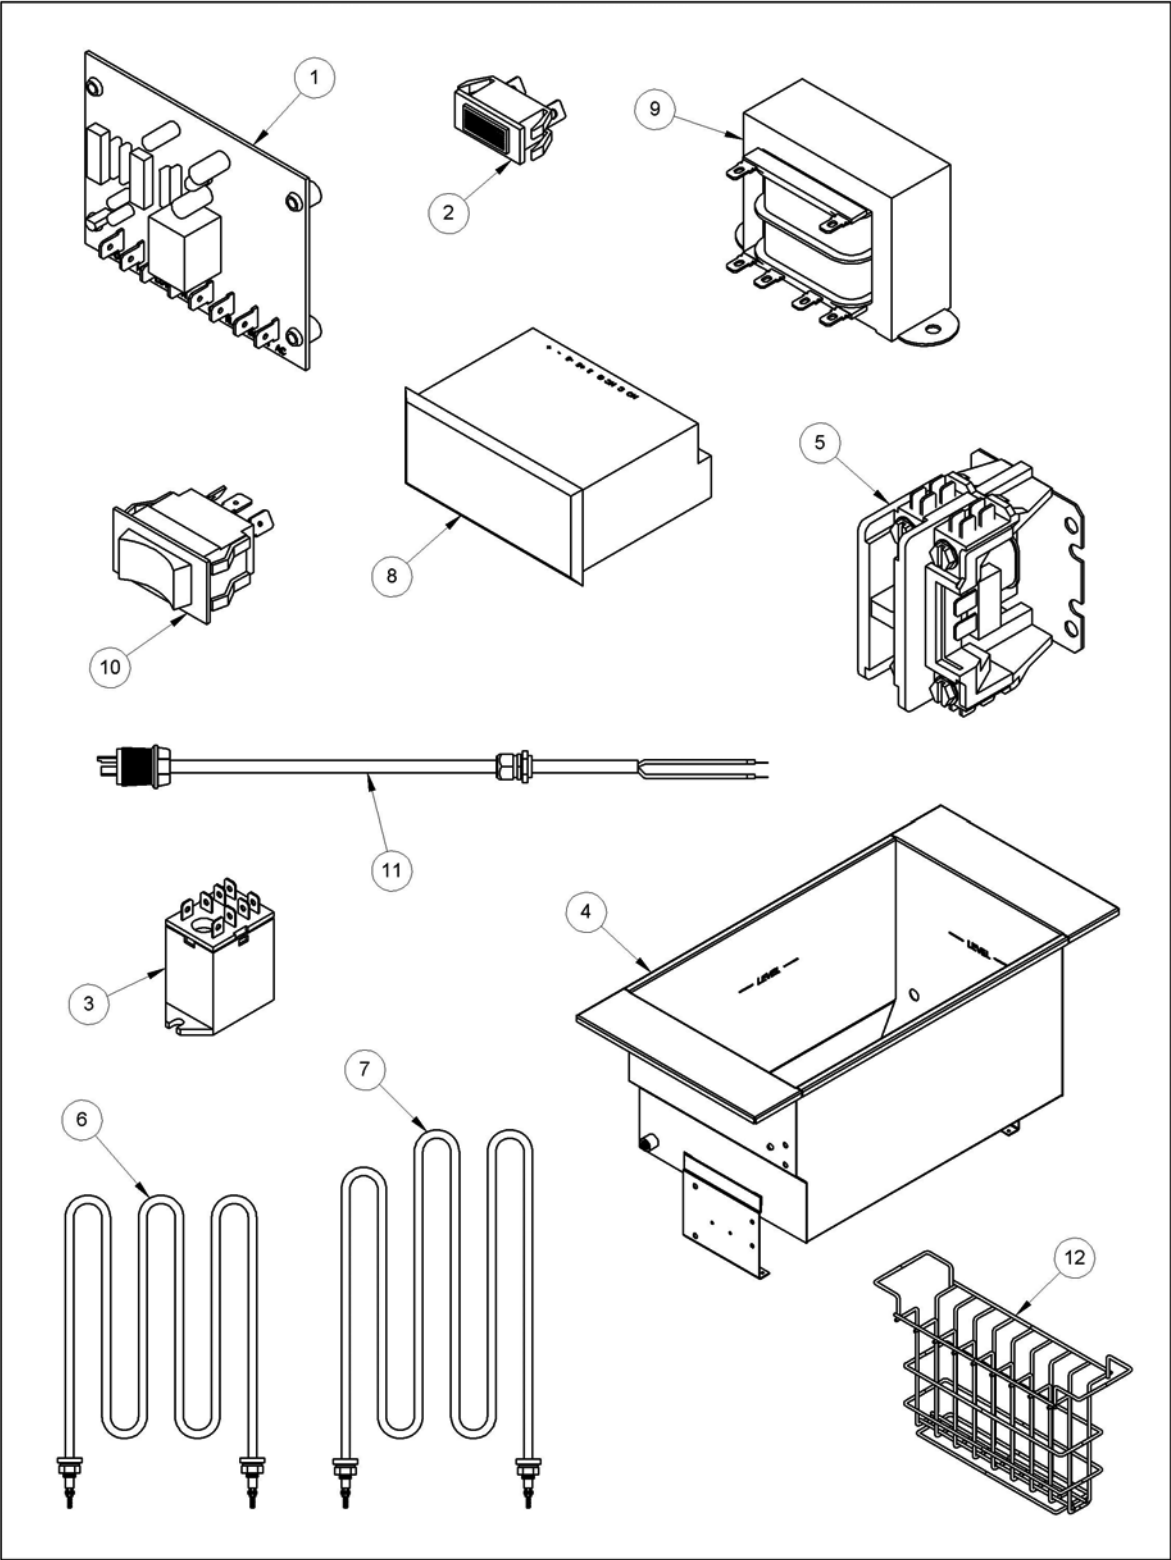



## PARTS LIST

Item	Part No.	Description	Digital	Solid State
1	60087202	Control, Liquid Level 24VAC	X	X
2	P5045044	Lamp, 28V Amber Rectangle	X	X
	P5045040	Lamp, 28V Red Rectangle		X
3	P5046688	Relay, 24VAC SPDT	X	X
4	B3323301	Tank, Weldment CRTE	X	X
5	60131201	Contact, 24V, 1 Pole 30A	X	X
6	P5046965	Element, Tubular 6KW 208V	Varies	
	P5046968	Element, Tubular 6KW 240V		
7	50008301	Element, Tubular 6KW 208V "New Style"		
	50008302	Element, Tubular 6KW 240V "New Style"		
8	60089502	Control, Thermostat Digital 24V 180F Green	X	
NS	60171201	Control, Thermostat Solid State 140-200F		X
NS	PP10704	Probe, Temperature CPI "Digital"	X	
NS	P8905-15	Probe, Temperature "Solid State"		X
NS	60128601	Switch, High Temperature Limit	X	X
9	PP10210	Transformer, 40VA 120/208/240V TO 24V	X	X
10	PP10559	Switch, Rocker DPDT 0-1-(1)	X	X
11	60129101	Cord, 30A Twist Lock Plug, NEMA-L6-30P	Varies	
	60129102	Cord, 30A Sleeved Twist Lock Plug, NEMA-L6-30P		
	60129103	Cord, 30A Angle Plug, NEMA-L6-30P		
	60129104	Cord, 30A Pin & Sleeve Plug, IEC 309-1 or IEC 309-2		
NS	60129001	Drain Hose, Assembly CRTE 4 Foot	X	X
12	B4512001	Rack, Soup	Varies	
NS	B3413501	Rack, 3 Product		

In the event of problems with or questions about your order, please contact the Pitco factory at:

(603) 225-6684 World Wide  
www.Pitco.com

In the event of problems with or questions about your equipment, please contact the Pitco Authorized Service and Parts representative (ASAP) covering your area, or contact Pitco at the numbers listed to the left.

MAILING ADDRESS – P.O. BOX 501, CONCORD, NH 03302-0501  
SHIPPING ADDRESS – 10 FERRY ST., CONCORD, NH 03301